



# Data Sheet

## AC Industrial Electric Motors

### Standards' organisations

The RS-ABB range of ac induction motors is produced to common European standards, these being IEC and CENELEC (Comité Européen de Normalisation Electrotechnique).

These two organisations work together on harmonisations of standards both worldwide and within Western Europe.

GENELEC in particular aims to remove trade obstacles in Western Europe that may occur due to differences in the regulations and standards.

New national standards are increasingly identical to or broadly based on these European standards issued by CENELEC.

### Dimensional and power standards

The first edition of IEC Publication 72 was issued in 1959 and supplemented in 1970 by IEC (International Electrotechnical Commission) Publication 72A.

These contained the first recommendations and outline proposals that electric motors should be produced with similar rated powers and mounting dimensions, i.e. shaft height, fixing dimensions and shaft extension dimensions.

In 1974 the joint agreement was superseded by a harmonisation document HD231 from CENELEC. The resulting standardisation enabled a complete interchangeability between motors of different manufacture. The sizes, versions and rated outputs of 4-pole and 2-pole motors covered by the standard are shown in Table 1.

However, the European standardisation does not fully coincide with corresponding USA standards, which tend to be based on imperial dimensions rather than the corresponding metric-based European motor. Power ratings also differ between US and European motors.

Three-phase induction motor



### Features

- Manufactured to metric frame sizes
- Totally enclosed fan cooled (TEFC) construction
- Environmentally protected to IP55
- Three-phase motors available in both foot and flange mounting
- Wide voltage range on three-phase motors of 220-240V/250-280V if delta ( $\Delta$ ) connected or 380-420/440-480V if star (Y) connected for motors up to frame size 100
- Wide voltage range 380-420/440-480V delta ( $\Delta$ ) connected or 660-690V star C $\Omega$  connected for motors with frame size 112 as above
- Suitable for use on 50/60Hz supplies
- Single-phase motors available in both permanent capacitor and capacitor start-run formats
- 2-pole and 4-pole motors available.

Table 1 Ratings according to IEC frame sizes IEC 34/1. IP55 For squirrel-cage motors

Frame Size	Rated output, KW	
	2 Pole	4 Pole
63B	0.25	0.18
71A	0.37	0.25
71B	0.55	-
71C	0.75	0.55
80A	0.75	0.55
80B	1.1	0.75
80C	1.5	1.1
90S	1.5	1.1
90L	2.2	1.5
90LB	2.7	2.2
100L	3.0	-
100LA	-	2.2
100 LB	4.0	3.0
100LC	-	4.0
112M	4.0	4.0
112MB	5.5	5.5
132S	-	5.5
132M	-	7.5
132MBA	-	9.2
132MB	-	11.0
132SA	5.5	-
132SB	7.5	-
132SBB	9.2	-
132SC	11.0	-
160M	15.00	11.0
160MA	11.0	-
160L	18.5	15.0
160LB	22.0	18.5

The meaning of the standardised letters in the size designation for sizes 90-132 are S = small, M = medium long and L = long version.

**Insulation classes**


IEC Publication IEC85 divides insulation into classes. Each class is given a designation that corresponds to the upper temperature limit of the insulating material when used under normal operating conditions.

The correct insulation of the winding of a motor is therefore determined by both the temperature rise in the motor and the temperature of the ambient air. If a motor is subjected to an ambient temperature higher than 40°C, it must normally be derated or a high insulation class of material used.


International standards measure temperature in degrees Celsius (°C), whilst temperature difference is stated in the unit Kelvin (K). One degree Celsius is equivalent to 1K.

The RS-ABB range of ac induction motors is manufactured to a class F insulation rating. For class F the temperature rise must not exceed 105K, provided that the ambient temperature does not exceed +40°C.

It should be noted that if the upper temperature limit of the insulation material is exceeded by 8 to 10K (Table 2), the life of the insulation will be approximately halved.

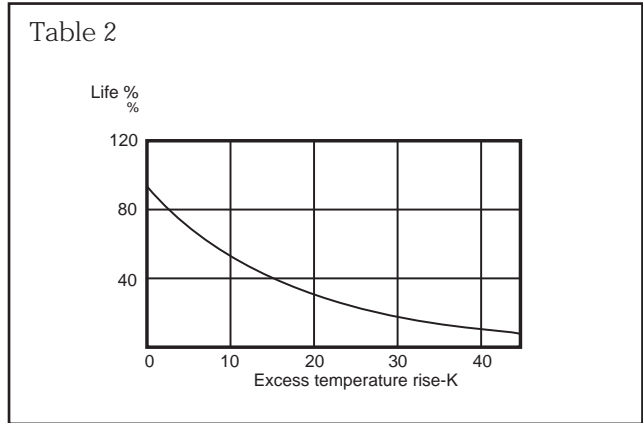

The graph illustrates the effect of exceeding the highest permitted winding temperature on winding life.

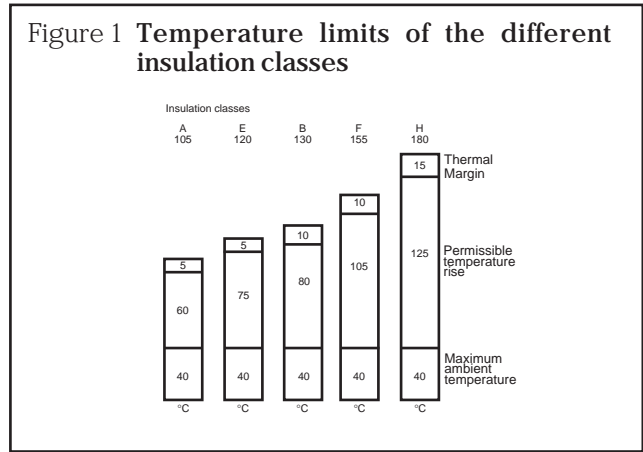

**General characteristics**

The following is a list of general characteristics of the ac induction motors supplied by RS Components. Each one should be considered before choosing the appropriate motor for the application.

**Voltage**

Single-speed, three-phase motors can usually be re-connected for two voltages.

The usual way is to connect the three stator phase windings in star (Y) or delta (Δ). All RS-ABB motors are supplied configured in star (Y) up to frame size 100 for 380-420V 50Hz, motors above this size are supplied delta primarily but may be converted for delta (Δ). This means that the three-phase input voltage range is wide. For example if the motor was connected in delta it would accept a three-phase input voltage range of 220-240V for a 50Hz supply frequency or 250-280V for 60Hz frequency.


Similarly with the motor connected in star an input voltage range of 380-420V is acceptable on 50Hz or 440-480V on a 60Hz supply system.

This wide voltage range and dual operating frequency enables the motors to be used throughout the world.

To convert the motors refer to Figure 2 where indication is given of the required link change.

**Note:** To use these motors in conjunction with single-phase 240V input, three-phase output ac motor speed controllers, these three-phase motors must be connected in delta (Δ).

Motors from frame size 112 are supplied delta connected for 380-420V 50Hz, 440-480V 60Hz. They can be connected in a star configuration for 660-690V 50Hz operation if required.

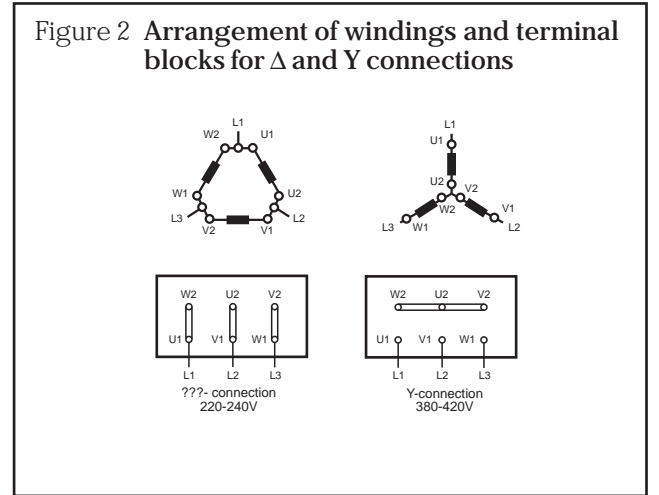


**Voltage deviation**

If the supply voltage at constant output power deviates from the rated voltage of the motor, the starting and maximum torques of the motor vary approximately as the square of the voltage.

The change in torque will also result in a change in the speed, efficiency and power factor (Figure 3).

Voltage deviations also affect the temperature rise in the motor windings. If the voltage is low the temperature will rise in both large and small framed motors; if the voltage is high the temperature may drop slightly in large sized motors but rise rapidly in the small output motors.

Figure 3

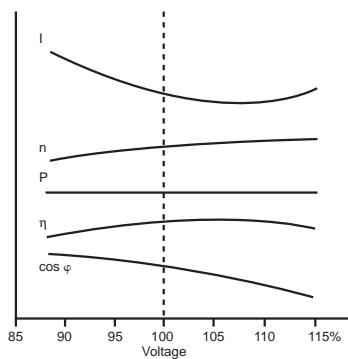

Graph showing current (I), speed (n), efficiency (η) and power factor (cos φ) as a function of the voltage at constant output (P).

### Power

When choosing a motor size it is essential to bear in mind that it is the power demand of the driven machine that determines the output delivered by the motor and therefore the power drawn from the supply. For example if a machine needs 4kW it will take 4kW, regardless of whether the motor is 3kW or 7.5kW.


If the smaller motor is installed it will be subjected to a continuous 25% overload that it will not be able to sustain for long periods. The protective overload device fitted should, however, protect against these types of high overloads, and disconnect the motor supply within a suitable time period.

A motor must be capable of delivering the power needed by the driven machine, and it is prudent to provide a safety margin since minor overloads that are difficult to foresee can often occur.

If a motor winding is overheated the insulation of the copper conductors may be destroyed. Given a choice between two motor sizes the larger one should always be used. However it is not a good idea to choose an unnecessarily large motor since it will be disproportionately costly to purchase and have a low power factor in service. In addition, when a squirrel cage motor is started the starting current will be excessively high, since it is proportional to the size of the motor. If a motor is loaded at full load only for short periods with periods of idling between them, known as intermittent duty, its temperature rise will be lower, and it will have a capacity to deliver a higher output than during continuous operation.

Figure 4 shows a typical temperature/time graph for a motor in both continuous and intermittent duty.

Figure 4

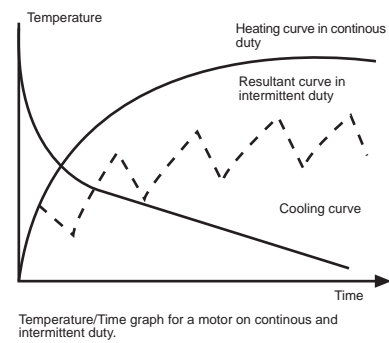


### Power factor

A motor consumes not only active power (kW), which it converts into mechanical work, but also reactive power (kVAr) which is needed for magnetisation but does not perform any useful function.

The active and reactive powers are shown in Figure 5 together with the apparent power (kVA). The ratio between the active power and the apparent power is known as the power factor. The angle between P (kW) and S (kVA) is usually designated  $\phi$ . The power factor usually being referred to as  $\cos \phi$ .

Figure 5

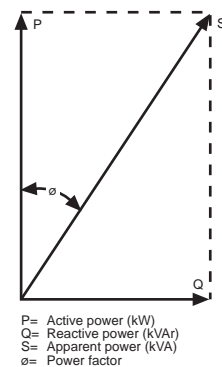

The power factor is usually between 0.7 and 0.9, however this may vary depending on the motor size and rating.

If there are many motors in an installation they will consume a lot of reactive power and will therefore have a lower power factor. Power supply authorities sometimes require the power factor of the installation to be raised. This is usually done by correction capacitors to the supply: these generate reactive power and thus raise the power factor level.

**Power factor correction**

With phase compensation the correction capacitors are usually connected in parallel with the motor or group of motors. Capacitors must not be connected in parallel with any single phases of the winding otherwise difficulty may be experienced in starting using star/delta methods.

To calculate the value of power factor correction capacitor required the following formula should be used:

$$C = 3.2 \times 10^6 \times \frac{Q}{U}$$

where C = Capacitance,  $\mu$ F  
 U = Capacitor voltage, V  
 Q = Reactive power, kVAr.

The reactive power is obtained by using the formula:

$$Q = K \times \frac{P}{\eta}$$

where K = constant from Table 2a  
 P = rated power of motor, kW  
 $\eta$  = efficiency of motor.

Table 2a

cos $\phi$ without compensation	Constant K Compensation to cos $\phi$ =			
	0.95	0.90	0.85	0.80
0.50	1.403	1.248	1.112	0.982
0.51	1.358	1.202	1.067	0.936
0.52	1.314	1.158	1.023	0.892
0.53	1.271	1.116	0.980	0.850
0.54	1.230	1.074	0.939	0.808
0.55	1.190	1.024	0.898	0.768
0.56	1.150	0.995	0.859	0.729
0.57	1.113	0.957	0.822	0.691
0.58	1.076	0.920	0.785	0.654
0.59	1.040	0.884	0.748	0.618
0.60	1.005	0.849	0.713	0.583
0.61	0.970	0.815	0.679	0.548
0.62	0.937	0.781	0.646	0.515
0.63	0.904	0.748	0.613	0.482
0.64	0.872	0.716	0.581	0.450
0.65	0.841	0.685	0.549	0.419
0.66	0.810	0.654	0.518	0.388
0.67	0.779	0.624	0.488	0.358
0.68	0.750	0.594	0.458	0.328
0.69	0.720	0.565	0.429	0.298
0.70	0.692	0.536	0.400	0.270
0.71	0.663	0.507	0.372	0.241
0.72	0.625	0.480	0.344	0.214
0.73	0.608	0.452	0.316	0.186
0.74	0.580	0.425	0.289	0.158
0.75	0.553	0.398	0.262	0.132
0.76	0.527	0.371	0.235	0.105
0.77	0.500	0.344	0.209	0.078
0.78	0.474	0.318	0.182	0.052
0.79	0.447	0.292	0.156	0.026
0.80	0.421	0.266	0.130	
0.81	0.395	0.240	0.104	
0.82	0.369	0.214	0.078	
0.83	0.343	0.188	0.052	
0.84	0.317	0.162	0.026	
0.85	0.291	0.135		
0.86	0.265	0.109		
0.87	0.238	0.082		
0.88	0.211	0.055		
0.89	0.184	0.027		
0.90	0.156			

**Efficiency**

IEC Publication 34-2 describes two methods for determining the efficiency of a motor, one being the direct method the other known as indirect.

With the indirect method input power and output are each measured individually. Most motor figures quoted are determined by this method, which also includes a calculation of the losses involved.


Typical motor losses include:

- Bearing and air friction losses
- Current heat losses in stator and rotor
- Iron losses
- Stray losses.

Figure 6 gives a graphic indication of the relationship between these losses.

The standards define the stray losses as 0.5% of the input power at rated duty. The standard tolerance is:

15% of (1 -  $\eta$ ) for motors up to 15kW where  $\eta$  = efficiency of motor. NEMA, the standards most widely used in the USA, permit no tolerance on the losses. Stray losses are generally calculated at 0.9% of the output.

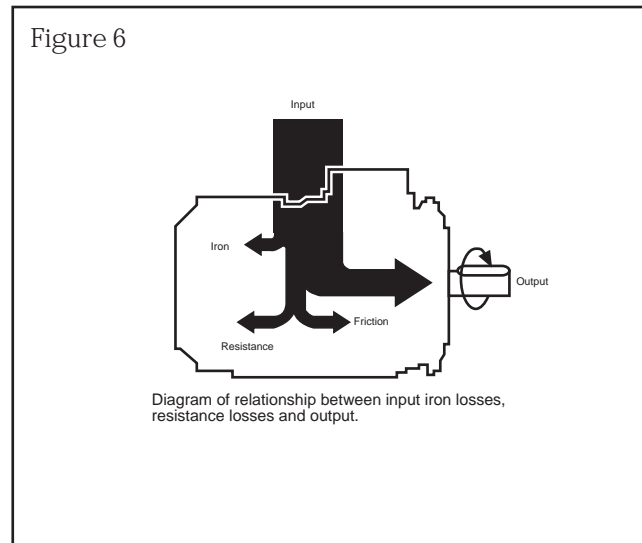

**Speed**

The speed of an ac motor depends on the mains frequency and the number of poles of the stator winding.

$$n = \frac{2.f.60}{P} \text{ r/min.}$$

where  
 n = speed  
 f = frequency  
 P = number of poles.

The rule of thumb to follow for a 50Hz mains frequency is that the speed in revolutions per minute (r/min. or rpm) is 6000 divided by the number of poles.

For example a 4-pole motor will have a synchronous speed of:

$$\frac{6000}{4} = 1,500 \text{ r/min.}$$

This speed can never actually be achieved on load due to slip. On no load, however, speed is practically equal to the synchronous speed.

To calculate slip the following equation can be used:

$$S = \frac{n_1 - n}{n_1} \times 100\%$$

where

S = slip %

$n_1$  = synchronous speed, r/min.

n = asynchronous speed, r/min.

Motor slip is proportional to the power taken from the motor.

#### For example

A 4-pole motor of 4kW at 415V, 50Hz, 1425 r/min.

At 4kW slip equals

$$S = \frac{1500 - 1425}{1500} \times 100 = 5\%$$

corresponding to  $1500 - 1425 = 75$  r/min.

At 3kW

$$S = \sqrt[3]{4} \times \frac{1500 - 1425}{1500} \times 100 = 3.8\%$$

corresponding to  $\sqrt[3]{4} \times (1500 - 1425) = 56$  r/min.

Therefore n at 3kW will be  $1500 - 56 = 1444$  r/min.

The slip is inversely proportional to the square of the voltage.

#### For example

4-pole motor, 4kW, 415V, 50Hz, 1425 r/min.

$$\begin{aligned} \text{At 380V; } S &= \left(\frac{415}{380}\right)^2 \times \frac{1500 - 1425}{1500} \times 100 \\ &= 5.96\% \end{aligned}$$

$$\begin{aligned} \text{corresponding to } &\left(\frac{415}{380}\right)^2 \times (1500 - 1425) \\ &89 \text{ r/min.} \end{aligned}$$

n will therefore be  $1500 - 89 = 1411$  r/min.

Table 3 gives details of synchronous speed for various numbers of motor poles and operation on either 50 or 60Hz.

Table 3

Poles	Synchronous speed at	
	50Hz	60Hz
2	3000	3600
4	1500	1800
6	1000	1200
8	750	900
10	600	720
12	500	600
16	375	450
20	300	360
24	250	300
32	187.5	225
48	125	150

## Operation at 60Hz

A motor wound for a given voltage at 50Hz can be used unmodified on a 60Hz supply: in such cases the motor data will change as shown in Table 4.

- Notes:**
1. That  $M_{\text{start}}/M$  and  $M_{\text{max}}/M$  must be calculated on the basis of the 60Hz value of M.
  2. The different torque figures at 60Hz. The starting torque and minimum torque figures in particular are reduced on 60Hz operation with the same supply voltage, this may lead to starting problems in certain applications.

Table 4

Motor wound for 50Hz and	Connection to 60Hz and	Data at 60Hz as % of 50Hz data				
		Output	$M^1$	$M_{\text{max}}/M^1$	$M_{\text{start}}/M^1$	Speed
220V	220V	100	83	85	70	120
	255V	115	96	98	95	120
380V	380V	100	83	85	70	120
	415V	110	91	93	85	120
	440V	115	96	98	95	120
	460V	120	100	103	100	120
415V	415V	100	83	85	70	120
	460V	110	91	94	85	120
	480V	115	96	98	95	120
500V	500V	100	83	85	70	120
	550V	110	91	94	85	120
	575V	115	96	98	95	120
	600V	120	100	103	100	120

1.  $M$  Rated torque at 60Hz
- $M_{\text{max}}/M$  Maximum torque/rated torque
- $M_{\text{start}}/M$  Starting torque/rated torque

Table 5


Quantity	Data at 50Hz	Conversion factor	Data at 60Hz
Voltage	380V	-	440V
Output	11kW	1.15	12.6kW
Current	23A	1.0	23A
$M_{\text{max}}/M$	2.4	0.98	2.4
$M_{\text{start}}/M$	2	0.95	1.9
Speed	1450 r/min	1.20	1740 r/min

Example of a typical conversion of data from 50 to 60Hz operation.

## Torque

The torque of a motor is the measure of its turning ability. If the power and speed are known it is easy to calculate the torque.

If we refer to Figure 7 we can see that at the periphery of a pulley there is a certain force in the belt. If this force is referred to as  $F$  and the radius of the pulley  $r$ , the product  $Fr$  is known as the torque  $M$  of the motor.

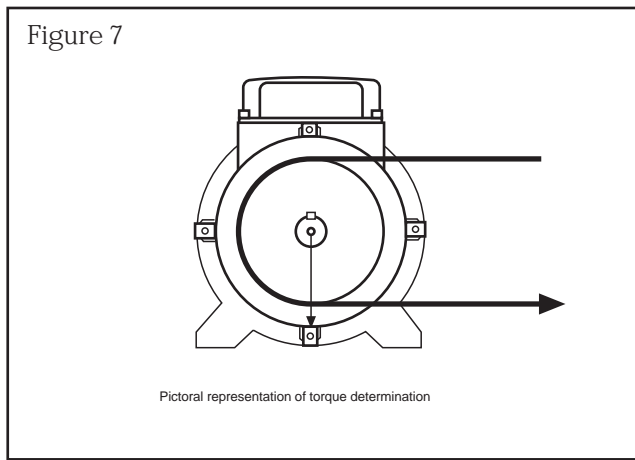

The power is the work performed by the motor per unit of time; work is force times distance. The force F rotates n revolutions in one minute and covers the distance  $n \times 2 \times \pi \times r$ .

During motor acceleration the torque developed first drops slightly then rises to its maximum (Figure 8).

In normal motors the maximum torque occurs at 85 to 90% of full speed.

At synchronous speed torque is zero.

To calculate the rated torque of a motor the following formula can be used:

$$M = \frac{30,000 \times P}{\pi \times n} \text{ Nm}$$

Where P = output, kW  
n = motor speed, r/min.


**For example**

A motor is rated at 1.5kW and 1400r/min. the diameter of pulley is 100mm i.e.  $r = 0.05\text{m}$ . The torque and traction developed at full power will be:

$$M = \frac{30,000 \times 1.5}{\pi \times 1400}$$

$$M = 10.2\text{Nm}$$

$$\text{Therefore } F = \frac{10.2}{0.05} = 205\text{N}$$

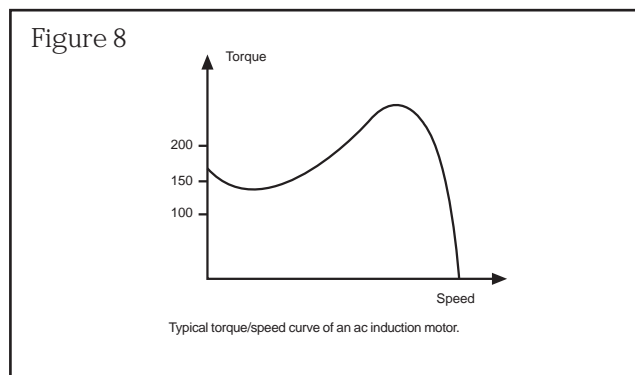

**Minimum torque**

IEC Publication 34-1 states certain figures for general purpose three-phase squirrel cage motors. For single-speed motors with rated output <100KW the minimum torque delivered during run up at rated voltage must not be less than 50% of the rated torque and not less than 50% of the starting torque. The figure for single-phase motors is 30% of the rated torque.


**Maximum torque**

The maximum torque is a measure of the overload capability of the motor IEC Publication 34-1 lays down that general purpose motors must be capable of developing at least 160% of the rated torque for 15 seconds - without stopping or suddenly changing speed - if the rated voltage or frequency is maintained. Four-pole motors made by ABB usually have a maximum torque that is approximately 200 to 300% of the rated torque. Low speed motors usually have a slightly lower maximum torque than high speed ones.

**Torque on voltage deviation**

With ac induction motors, the starting current decreases slightly more than proportionately to the voltage. Thus at 90% of the rated voltage the motor draws approximately 87-89% of the starting current.

The starting torque is proportional to the square of the current. The torque delivered at 90% of rated voltage is therefore only 75-79% of the starting torque. This factor may be of particular importance when choosing a motor for use on a weak electrical supply or when starting techniques based on current reduction methods are employed (Figure 9).

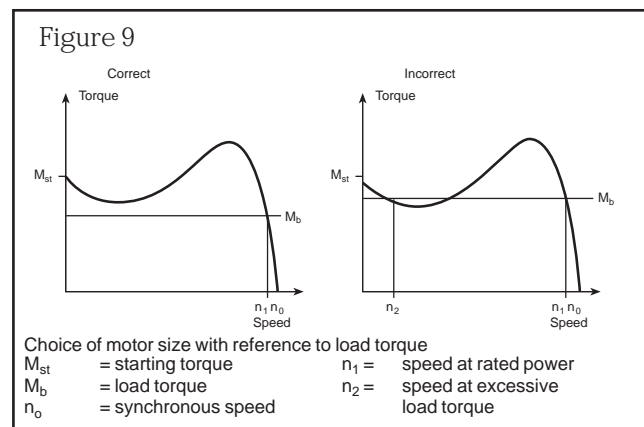

**Frequency of starting and reversing**

When a motor is frequently started, counter-current braked or reversed, extra heat, due to the increase in losses, is produced reducing the motors ability to perform at its rated loaded output.

The following formula can be used to obtain an approximate value.

$$\overline{P2} = P1 \times \sqrt{\frac{3600 - k_1 \times X \times ts \times \left(\frac{1st}{1}\right)^2}{3600 - X \times ts}}$$

where

P2 = permitted load

P1 = rated output of motor

X = number of starts, braking or reversals per hour

ts = starting or braking time

$\frac{1st}{1}$  = starting current/braking current

K<sub>1</sub> = constant: 1 for starting, 3 for braking and 4 for reversing.

The permitted value of X is determined with regards to the temperature rise within the motor.

### For example

A 4-pole motor 4kW,  $\frac{1st}{1} = 5.5$

starting time ts = 0.5s. X = 10 starts per hour.  
Therefore

$$\frac{P2}{P1} = \sqrt{\frac{3600 - 1 \times 10 \times 0.5 \times (5.5)^2}{3600 - 10 \times 0.5}} = .979$$

If the same formula is used to calculate the required derating on 10 reversals per hour

$$\frac{P2}{P1} = \sqrt{\frac{3600 - 4 \times 10 \times 0.5 \times (5.5)^2}{3600 - 10 \times 0.5}} = .912$$

### Types of duty


Various types of duty have been defined by IEC Publication 34-1 that describe how the load, and thus the motor output varies with time. The motor must undergo a load test without exceeding the temperature limits laid down in the specification.

Actual operating conditions are often of a more irregular nature than those corresponding to any of the standard duty types. It is therefore essential that when choosing and rating a motor to decide on the type of duty that corresponds best to the thermal stresses that are expected to occur in practice.

The most standard types of duty classes are:


#### S1 continuous duty

Operation at a constant load, long enough for thermal equilibrium to be reached (Figure 10).

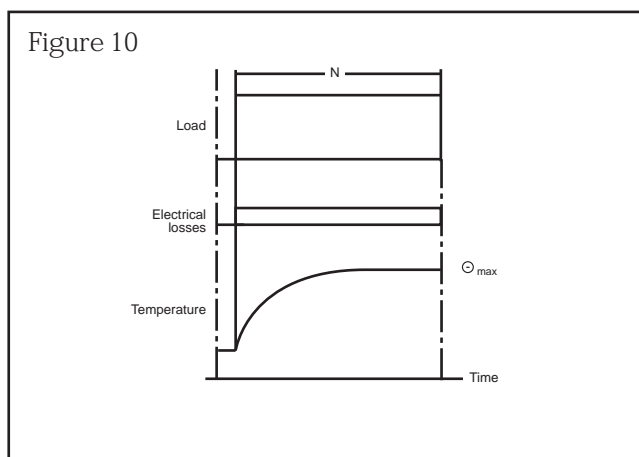

#### S2 short time duty


Operation at constant load for a given time that is shorter than the time needed to reach thermal equilibrium, followed by a rest and de-energised period. De-energisation period should be long enough to allow the motor to reach a temperature that does not deviate from the temperature of the cooling medium by 2K (Figure 11).

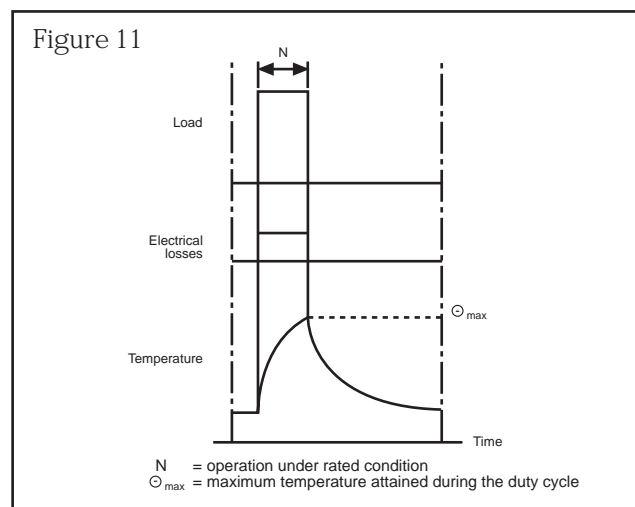

#### S3 intermittent duty

A sequence of identical duty cycles, where each cycle is in two parts, one at constant load and the other at rest and de-energised. In this type of duty the starting current has no significant effect on the temperature rise. The duty cycle is too short for thermal equilibrium to be reached (Figure 12).


Figure 12

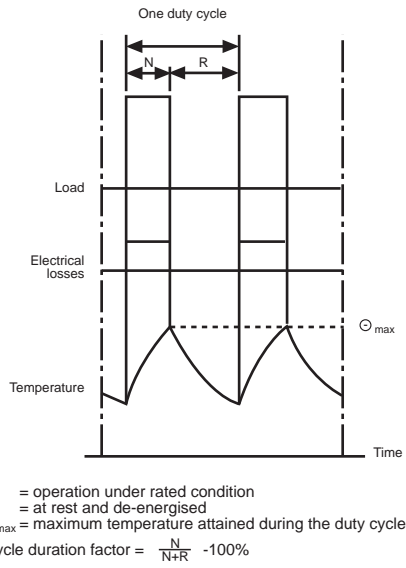

**S4 intermittent duty with starting**

A sequence of individual duty cycles, where each cycle consists of a start that is sufficiently long to have a significant effect on the motor temperature, a period of constant load and a period at rest and de-energised. In this type of duty the starting current is insignificant on the temperature rise. The duty cycles are too short for thermal equilibrium to be reached (Figure 13).


Figure 13

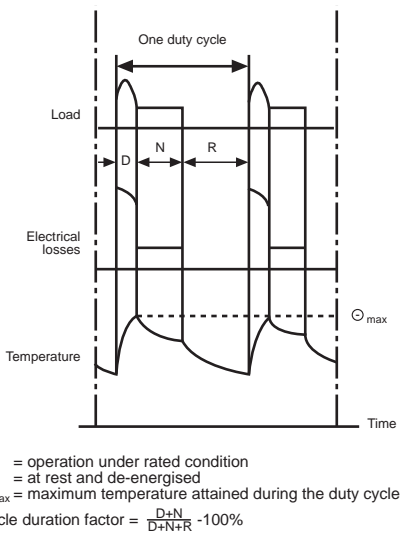

**S5 intermittent duty with electrical braking**

A sequence of identical duty cycles, where each cycle consists of a start, a period at constant load followed by rapid electrical braking, and a rest and de-energised period. The duty cycle is too short for thermal equilibrium to be reached (Figure 14).

Figure 14

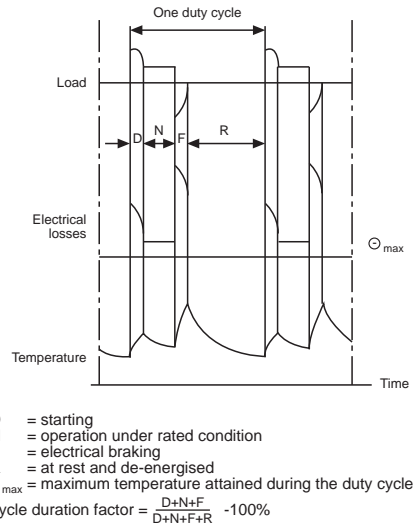


**S6 continuous operation**

**Periodic duty**

A sequence of identical duty cycles, where each cycle is in two parts, one at constant load and the other at no load, no rest and no de-energised period. The duty cycles are too short for thermal equilibrium conditions to be reached (Figure 15).




Figure 15

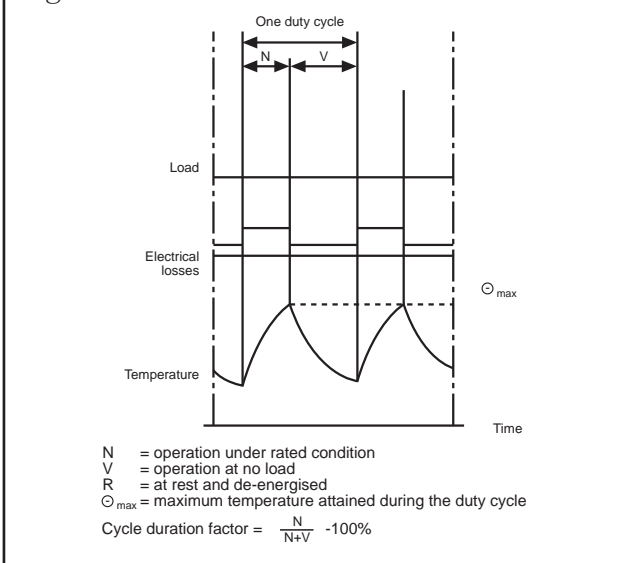

**S7 continuous operation, periodic duty with electrical braking**

A sequence of identical duty cycles, where each cycle consists of a start and a period at constant load, followed by electrical braking, no rest and de-energised period. The duty cycles are too short for thermal equilibrium conditions to be reached (Figure 16).

Figure 16

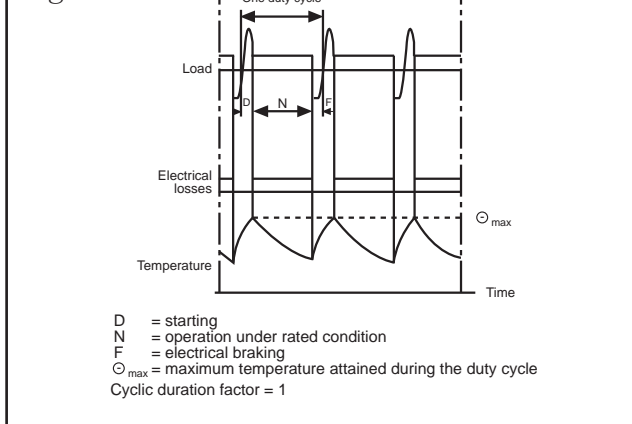

**Upgrading**

Because of the lower temperature rise in a motor operated on short time or intermediate duty it is usually possible to take a higher output from the motor on these types of duty than on continuous duty S1. Table 6 gives details.

Table 6

Short-time duty, S2	Poles	Permitted output as % of rated output in S1 continuous duty for motor size:	
		63-100	112-250
30 min	4-8	110	120
60 min	2-8	100	110
Intermittent duty, S3	Poles	Permitted output as % of rated output in S1 continuous duty for motor size:	
		63-100	112-250
15%	4	140	145
25%	4	130	130
40%	4	120	110
60%	4	110	107

**Changing direction**

**Three-phase motors**


If the mains supply to the stator terminals marked U, V and W of a three-phase motor and the phase sequence of the mains is L1, L2, L3, the motor will rotate clockwise (when viewed from the drive end). To reverse direction interchange any two of the three cables connected to the starter device or the motor.

**Single-phase motors**

**Capacitor start - capacitor run type**

To reverse the direction of this type of motor the blue and yellow cables connected to terminals 3 and 12 should be interchanged (Figure 17).


Figure 17

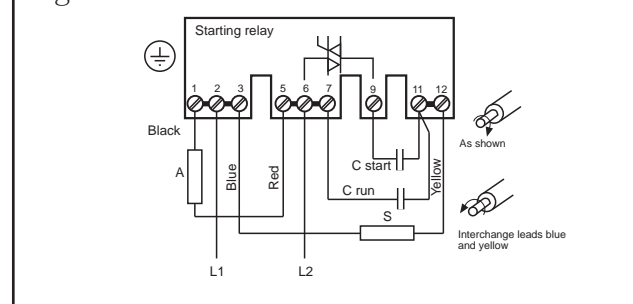

**Permanent split capacitor type**

To reverse the direction of this type of motor the connected capacitor should be moved from between terminals U1 and U5 to U1 and Z2 (refer to Figure 18).

Figure 18

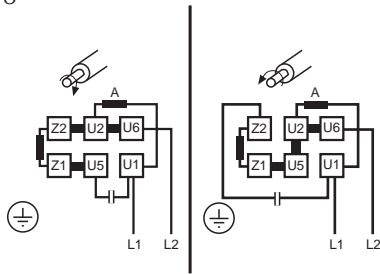

**Single-phase motor variations  
CSR (Capacitor start and run)**

Motors are fitted with both a separate start and run capacitor. These motors are also fitted with an electronic relay which prevents any risk of damage to the starting capacitor either during heavy start or overload of the motor.

CSR motors have a starting torque of approximately 160% of full load torque, making them ideal for driving compressors, piston pumps, high pressure cleaners, etc.


**CSR motor (single-phase)**



**PSC (permanent split capacitor)**

These motors are fitted with one capacitor only that is connected in circuit both during starting and running. These motors tend to have lower starting torques typically between 25 and 50% of full load torque. PSC meters are particularly suitable for use on drives having comparatively light starting loads such as fans and centrifugal pumps.

**PSC motor (single-phase)**

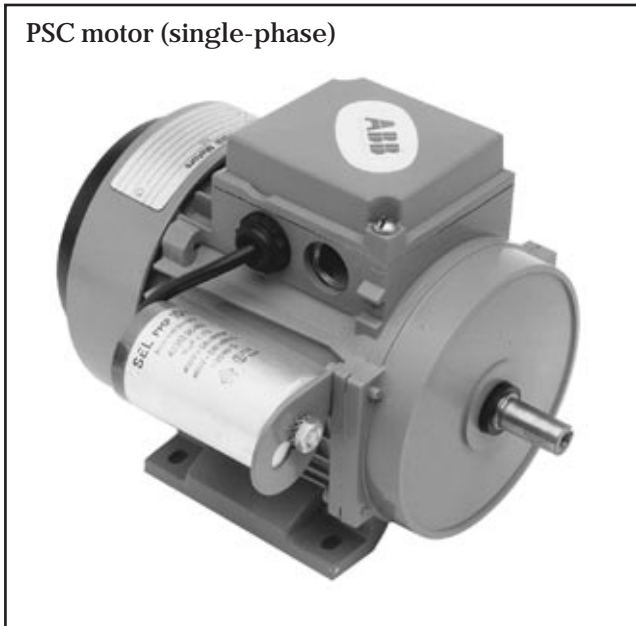

**Motor types**

**3-phase motor 4-pole, Foot mounted**

Rating kW (hp)	Frame size	ABB ref. Old	RS stock no.	ABB ref. New
.18 (.25)	63B	MK1100 15-S	320-023	AA062002ASA
.25 (.33)	71A	MK110016-S	196-3924	AA072002ASA
.37 (.50)	71B	MK110017-S	320-039	AA072002ASA
.55 (.75)	80A	MK110018-S	320-045	AA082001ASA
.75 (1.0)	80B	MK110019-S	320-051	AA082002ASA
1.1 (1.5)	90S	MK110020-S	320-067	AA092001ASA
1.5 (2.0)	90L	MK110021-S	320-073	AA092002ASA
2.2 (3.0)	100LA	MK110022-S	320-089	AA102001ASA
3 (4.0)	100LB	MK110023-S	320-095	AA102002ASA
4 (5.5)	112M	AA112001-ADA	320-102	AA112001-ADA
5.5 (7.3)	132S	AA132001-ADA	193-1719	AA132001-ADA
7.5 (10)	132M	AA132002-ADA	193-1725	AA132001-ADA


**3-phase foot mounted 2-pole**

Rating kW (hp)	Frame size	ABB ref. Old	RS stock no.	ABB ref. New
.25 (.33)	63B	MK1100 04-S	266-698	AA061002ASA
.37 (.50)	71A	MK110005-S	266-705	AA071001ASA
.55 (.75)	71S	MK110006-S	266-711	AA071002ASA
.75 (1.0)	80A	MK110007-S	266-727	AA081001ASA
1.1 (1.5)	80B	MK110008-S	266-733	AA081002ASA
1.5 (2.0)	90S	MK110009-S	266-749	AA091001ASA
2.2 (3.0)	90LLA	MK110010-S	266-755	AA091002ASA
3 (4.0)	100LB	MK110011-S	266-761	AA101001ASA

**Flange mounted 4-pole**

Rating kW (hp)	Frame size	ABB ref. Old	RS stock no.	ABB ref. New
.37 (.50)	71B	MK1100 57-S	320-118	AA072002BSA
.55 (.75)	80A	MK110058-S	320-124	AA082001BSA
.75 (1.0)	80B	MK110059-S	320-130	AA082002BSA
1.1 (1.5)	90S	MK110060-S	320-146	AA092001BSA
1.5 (2.0)	90L	MK110061-S	320-152	AA092002BSA
2.2 (3.0)	100LA	MK110062-S	320-168	AA102001BSA

Foot mounted motors

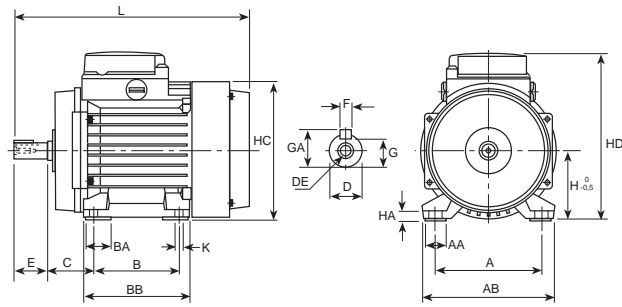

MAIN DIMENSIONS

FRAME SIZE	C	H	HC	HD	L
63	40	63	123	150	213
71	45	71	141	172	240
80	50	80	159	192	272
90S	56	90	179	212	195
90L	56	90	179	212	320
100L	63	100	199	236	358
112M	70	112	221	268	372
132S	89	132	263.5	295.5	447
132M	89	132	263.5	295.5	447
160M	108	160	318	370	596
160L	108	160	318	370	596

SHAFT END

	D	DE	E	F	G	GA
14	M5	30	5	11	16	
14	M5	30	5	11	16	
19	M8	40	6	15.5	21.5	
24	M8	50	8	20	27	
24	M8	50	8	20	27	
28	M10	60	8	24	31	
28	M10	60	8	24	31	
38	M12	80	10	33	41	
38	M12	80	10	33	41	
42	M16	110	12	37	45	
42	M16	110	12	37	45	


FOOT DIMENSIONS

FRAME SIZE	A	AA	AB	B	BA	BB	HA	K
63	100	16	120	80	19	98	7	7
71	112	20	136	90	21	112	9	7
80	125	25	154	100	30	125	10	10
90S	140	27	170	100	30	125	10	10
90L	140	27	170	125	30	150	10	10
100L	160	32	197	140	34	172	12	12
112M	190	38	222	140	36	174	12	12
132S	216	47	262	140	40	212	14	12
132M	216	47	262	178	40	212	14	12
160M	254	60	312	210	50	292	18	15
160L	254	60	312	254	50	292	18	15

TERMINAL BOX CABLE ENTRIES

QTY.	THREAD (DIN 40430)
2	Pg11
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg29
2	Pg29

FLANGE MOUNTED MOTORS

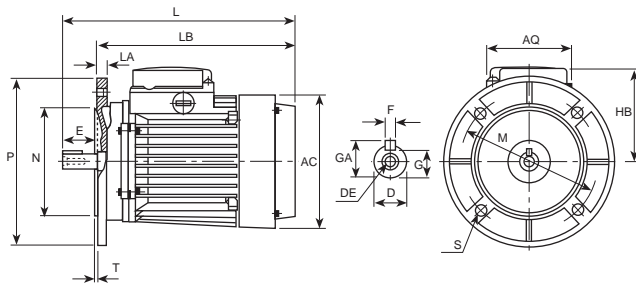

MAIN DIMENSIONS

FRAME SIZE	AC	AQ	HB	L	LB
71	140	85	102	240	210
80	158	97	112	272	232
90S	178	97	122	295	245
90L	178	97	122	320	270
100L	198	97	136	358	298
132S	261	160	163.5	447	367
132M	261	160	163.5	447	367

SHAFT END

	D	DE	E	F	G	GA
14	M5	30	5	11	16	
14	M5	30	5	11	16	
19	M8	40	6	15.5	21.5	
24	M8	50	8	20	27	
24	M8	50	8	20	27	
28	M10	60	8	24	31	
38	M12	80	10	33	41	
38	M12	80	10	33	41	

FLANGE DIMENSIONS

FRAME SIZE	IEC-FLANGE	LA	M	N	P	S	T
71	F130	9	130	110	160	10	3-5
80	F165	10	165	130	200	12	3-5
90S	F165	10	165	130	200	12	3-5
90L	F165	10	165	130	200	12	3-5
100L	F215	11	215	180	250	15	4
132S	-	14	265	230	300	14.5	4
132M	-	14	265	230	300	14.5	4

TERMINAL BOX CABLE ENTRIES

QTY.	THREAD (DIN 40430)
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16
2	Pg16

Motor selection tables: 4 pole

Size	63B	71B	80A	80B	90S	90L	100LA	100LB	112M	132S	132M	160M	160L
kW	.18	.37	.55	.75	1.1	1.5	2.2	3	4	5.5	7.5	11	15
hp	.25	.5	.75	1.0	1.5	2.0	3	4	5.5	7.3	10	14.7	20
Actual speed	1370	1400	1410	1410	1410	1420	1430	1430	1430	1440	1440	1455	1455
Power factor	.57	.60	.62	.66	.69	.71	.72	.73	.84	.81	.82	.85	.86
FLC	.8	1.25	1.65	2.1	2.9	3.7	5.2	6.9	9.1				
Load torque	1.25	2.5	3.7	5	7.5	10	15	20	27	36	49	72	98
Wt.	4.5	6.5	9	10	13	16	20.5	23.5	31	40	48	72	87

2 pole

Size	63B	71B	80A	80B	90S	90L	100LA	100LB	112M
kW	.25	.37	.55	.75	1.1	1.5	2.2	3	4
hp	0.33	.5	.75	1.0	1.5	2.0	3	4	5.5
Actual speed	2750	2820	2820	2850	2850	2860	2870	2890	2840
Power factor	.65	.69	.73	.76	.79	.79	.82	.83	.85
FLC	0.8	1.05	1.45	1.85	2.6	3.5	4.7	6.2	7.5
Load torque	0.84	1.25	1.9	2.5	3.7	5	7.5	10	13.4
Wt.	4.5	5.5	6.5	9	10	13	16	21	30

Note: FLC is given for star connection, except for the 122m frame motors


Highest permissible no. of starts per hour at no-load		
frame size	4 pole motor	2 pole motor
63B	8700	11200
71A	-	9100
71B	8000	-
80A	8000	5900
80B	8000	4900
90S	7700	4200
90L	7000	3500
100L	-	2800
100LA	5200	-
100LB	4500	-
112M	6700	3700

Max. starting duration in seconds for direct-on line at rated voltage		
frame size	4 pole motor	2 pole motor
63	40	25
71	20	20
80	20	15
90	20	10
100	15	10
112	15	12

Single-phase motors capacitor start-run 4-pole

Rating kW	(hp)	Frame size	ABB ref.	RS stock no.
37	(.50)	71B	MK111312-B	320-297
55	(.75)	80A	MK111313-B	320-304
75	(1.0)	80B	MK111314-B	320-310
1.1	(1.5)	90S	MK111315-B	320-326

232-5812

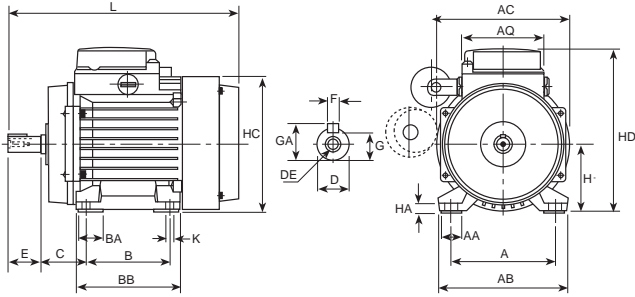

MAIN DIMENSIONS

TYPE	AC	AQ	C	H	HC	HD	L	D	DE	E	F	G	GA
MT63	120	85	40	63	123	150	213	14	M5	30	5	11	16
MT71	140	85	45	71	141	172	240	14	M5	30	5	11	16
MT80	158	97	50	80	159	192	272	19	M8	40	6	15.5	21.5
MT90S	178	97	56	90	179	212	295	24	M8	50	8	20	27


SHAFT END

FOOT DIMENSIONS

A	AA	AB	B	BA	BB	HA	K
100	16	120	80	19	98	7	7
112	20	136	90	21	112	9	7
125	25	154	100	30	125	10	10
140	27	170	100	30	125	10	10

Permanent split capacitor 2-pole

Rating		Frame size	ABB ref Old	RS stock no.	ABB ref New
kW	(hp)				
.18	(.25)	63B	1756109	209-6930	MK111601-E

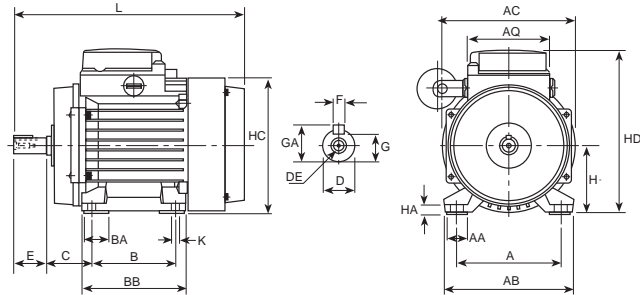

MAIN DIMENSIONS

TYPE	AC	AQ	C	H	HC	HD	L	D	DE	E	F	G	GA
MT63	120	85	40	63	123	150	213	14	M5	30	5	11	16
MT71	140	85	45	71	141	172	240	14	M5	30	5	11	16
MT80	158	97	50	80	159	192	272	19	M8	40	6	15.5	21.5
MT90S	178	97	56	90	179	212	295	24	M8	50	8	20	27

SHAFT END

FOOT DIMENSIONS

A	AA	AB	B	BA	BB	HA	K
100	16	120	80	19	98	7	7
112	20	136	90	21	112	9	7
125	25	154	100	30	125	10	10
140	27	170	100	30	125	10	10

4 pole

Frame size	71B	80A	80B	90S
kW	.37	.55	.75	1.1
hp	.5	.75	1.0	1.5
Actual speed	1330	1400	1400	1410
Power factor	.99	.99	.99	.99
FLC	2.9	3.9	5.2	7.2
Load torque	2.5	3.7	5	7.5
Net weight	6.5	9	10	13

2 pole

Frame size	71A	71B	80A	80B
kW	.37	.55	.75	1.1
hp	.5	.75	1.0	1.5
Actual speed	2850	2850	2870	2870
Power factor	.99	.99	.99	.99
FLC	2.6	3.8	4.9	7
Load torque	1.25	1.9	2.5	3.7
Net weight	5.5	6.5	9	10

Permanent split capacitor  
Foot mounted 4-pole

Rating		Frame size	ABB ref.	RS stock no.
kW	(hp)			
.18	(.25)	63B	MK111810-E	320-247
.37	(.50)	71B	MK111812-E	320-253

Motor selection tables: 4 pole

Frame size	63B	71B	80A	80B	90S
kW	.18	.37	.55	.75	1.1
hp	.25	.5	.75	1.0	1.5
Actual speed	1370	1380	1400	1400	1400
Power factor	.95	.99	.99	.99	.99
FLC	1.6	2.9	3.9	5.2	7.1
Load torque	1.3	2.5	3.7	5	7.5
Net weight	4.5	6.5	9	10	10

2 pole

Frame size	63B	71A	71B	80A	80B
kW	.25	.37	.55	.75	1.1
hp	.33	.5	.75	1.0	1.5
Actual speed	2750	2850	2850	2870	2870
Power factor	.99	.97	.99	.99	.99
FLC	2	2.6	3.8	4.9	7
Load torque	.85	1.25	1.9	2.5	3.7
Net weight	4.5	5.5	6.5	9	10

RS Components shall not be liable for any liability or loss of any nature (howsoever caused and whether or not due to RS Components' negligence) which may result from the use of any information provided in RS technical literature.